



Compression Board Air Seal With Flush Gravel Stop Up To 80 MPH Wind Rider *

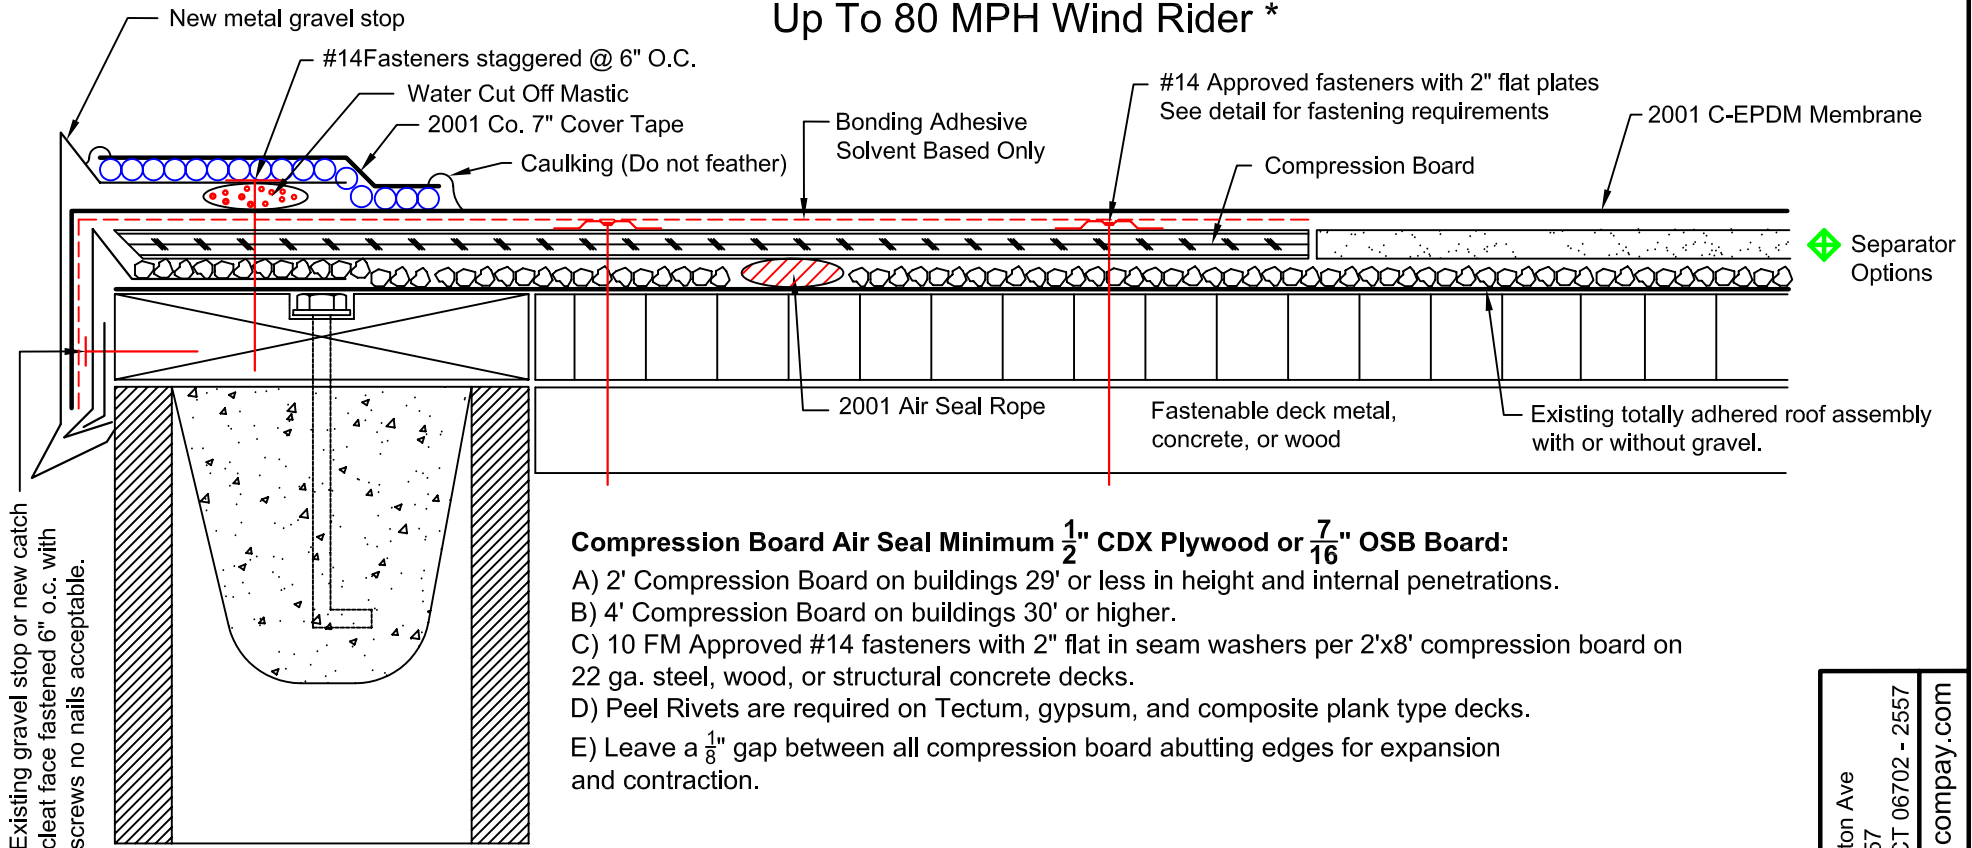

Compression Board Air Seal Minimum $\frac{1}{2}$ " CDX Plywood or $\frac{7}{16}$ " OSB Board:


- A) 2' Compression Board on buildings 29' or less in height and internal penetrations.
- B) 4' Compression Board on buildings 30' or higher.
- C) 10 FM Approved #14 fasteners with 2" flat in seam washers per 2'x8' compression board on 22 ga. steel, wood, or structural concrete decks.
- D) Peel Rivets are required on Tectum, gypsum, and composite plank type decks.
- E) Leave a $\frac{1}{8}$ " gap between all compression board abutting edges for expansion and contraction.

Hurricane Backwrap compression board details required on **Wind Riders over 80 MPH and in states where solvent base adhesives are prohibited.**

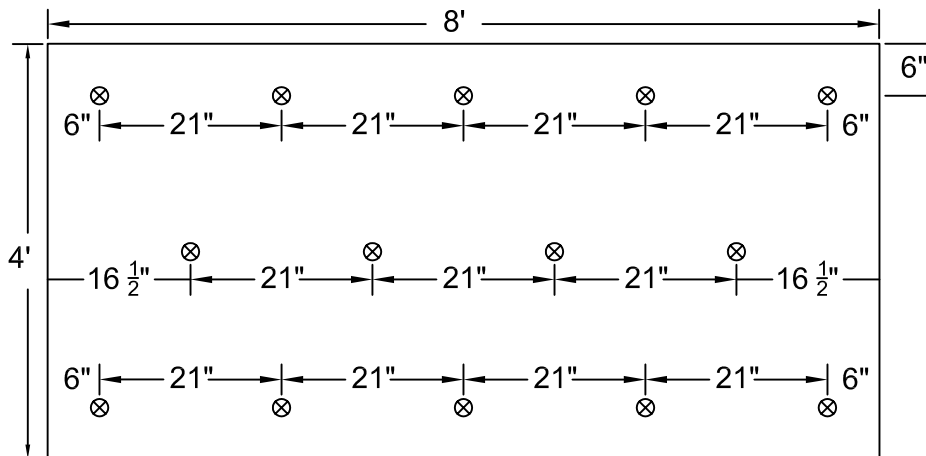

Separator Options:

- 1) 2001 Gravel Mat
- 2) $\frac{1}{2}$ " Gypsum loose laid
- 3) Insulation mechanically fastened with 8 fasteners per 4x8 panel and 4 fasteners per 4x4 panel to keep insulation from bowing.

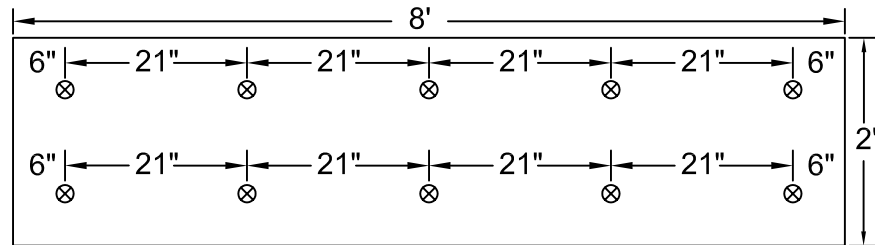

* For greater than 60 MPH Wind Rider, Air Seal details and deck air seal methods must be pre approved by 2001 Company

E-OSB-100-D	Drwn by: Anton D Simms
C-EPDM-FD-CB-GS-80	
© Thomas L Kelly Patent Pending	

325 Thomaston Ave
P.O. Box 2557
Waterbury, CT 06702 - 2557
www.2001company.com

